

SUH

Application Area

Opening fire ventilators equipped with retaining magnets.

Control

Manually by section or automatically via smoke detector.

Capacity

We recommend 10-15 ventilators per section, unlimited number of sections.

Power Supply

Powered by 24V DC from external source, such as the BLAB Power Supply Unit.

Cabinet and Configuration

Class IP 54.

Control buttons with lead-secured cover.
LED indicates 24V DC battery voltage.

Labelling

Signs: "CONTROL UNIT, FIRE VENT"
"SECTION 1, SECTION 2" ...
"BATTERY VOLTAGE"

Dimensions

Total sections	Width	Height	Depth
1-2	125	175	125
3	175	175	125
4-5	250	175	150
6-7	380	190	131
8-10	380	300	155

Specification

SUH-X Control Unit (X=total sections)

Smoke Detector Connection


Terminals for connecting smoke detectors are in the cabinet.

Connection diagram, 24V DC – Diagr. no. 30542

Connection diagram, 220V AC – Diagr. no. 30543

Accessories (Optional)

Relay for connection from fire alarm control unit

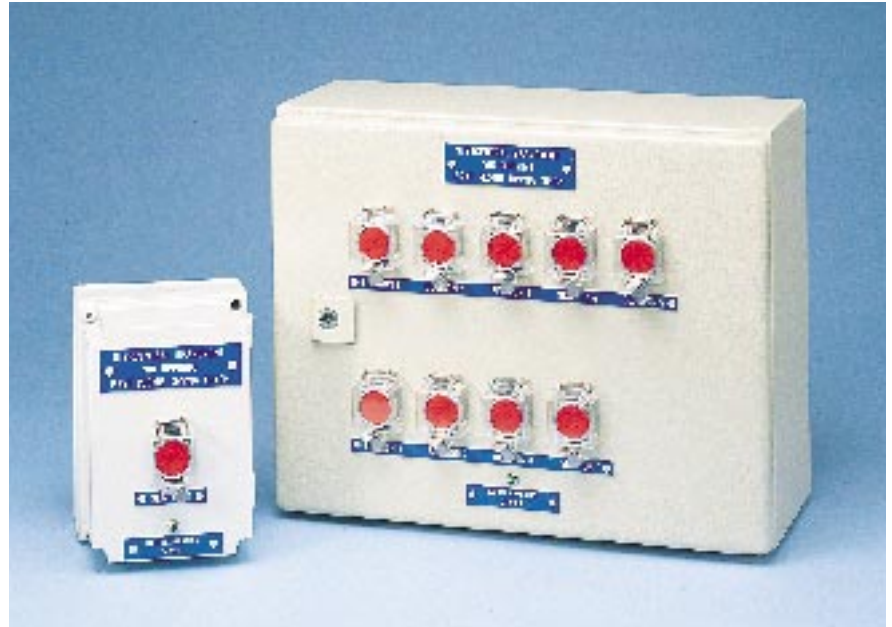

SUHL

Same as SUH Control Unit except:

Indication

Indicator lights in buttons when ventilators in the section open.

Specification

SUHL-X Control Unit (X=total sections)